

START DATE 19/01/2023
END DATE 26/01/2023

APPLICANT

RESIN PRO SRL
Via XXV Aprile Z.I. Snc
19021 Arcola SP

SAMPLE DESCRIPTION
Sample Received 19/01/2023
Quotation No. 48/FCA
Reference: ICRYSTAL FIVE / EPOXYTABLE FIVE
Colour TRASPARENTE
End Use: APPLICAZIONI VARIE
Material Type: RESINA EPOSSIDICA
Supplier RESIN PRO
Buyer: PRIVATO E PROFESSIONISTA
Buyer's Name: RESIN PRO SRL

Sample 01


Test	Rating	Failure result
12003 - Phthalate plasticizers content CPSC-CH-C1001-09.4:2018 Consumer Product Safety Improvement Act (CPSIA)- children's toys and certain child care articles	P	
12000 - Total Lead Content CPSC-CH-E1002-08.3:2012	P	

P = MEETS REQUIREMENT / A = ACCEPTABLE / F = DOES NOT MEET REQUIREMENT / NR = NO REQUIREMENT / SC = STILL CONTINUES / X = NOT PERFORMED
Values in brackets represent the limits



LAB N° 0579 L

START DATE 19/01/2023
END DATE 26/01/2023

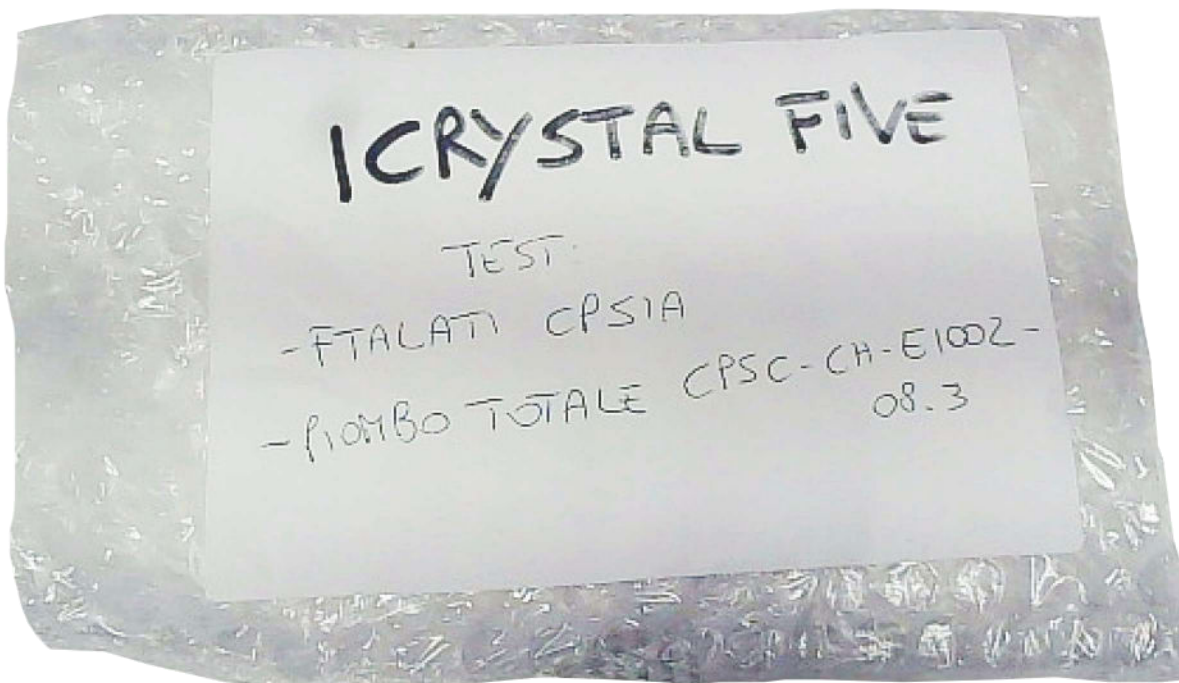

LAB N° 0579 L

START DATE 19/01/2023

END DATE 26/01/2023

TEST METHOD	SAMPLE DESCRIPTION	PARAMETERS	RESULT	U.M.	LIMITS	LQ	NOTES	LAB
12003 - Phthalate plasticizers content CPSC-CH-C1001-09.4:2018 Consumer Product Safety Improvement Act (CPSIA)- children's toys and certain child care articles	01	BBP-Butyl benzyl phthalate 85-68-7	< 30	mg/kg	1000	30		ITA
		DBP-Di-butyl phthalate 84-74-2	< 30	mg/kg	1000	30		ITA
		DEHP-Di-(2-ethylhexyl) phthalate 117-81-7	< 30	mg/kg	1000	30		ITA
		DIDP-Di-isodecyl phthalate 26761-40-0	< 90	mg/kg	1000	90	*	ITA
		DINP-Di-isononyl phthalate 28553-12-0	< 60	mg/kg	1000	60		ITA
		DNOP-Di-n-octyl phthalate 117-84-0	< 30	mg/kg	1000	30	*	ITA
		12000 - Total Lead Content CPSC-CH-E1002-08.3:2012	01	Lead 7439-92-1	< 20	mg/kg	100	20

Test performed by:

ITA: Intertek Italia S.p.a.

Via di Stagno 17 F/G

50055 Lastra a Signa (FI)

Tests marked with star (*) haven't been Accredia accredited.

The partial reproduction of the present Test Report is not allowed without written authorization of the General Manager.

The content of the present document refers exclusively to the submitted samples and not to the batch that they want to represent.

A representative portion of the sample is kept for 60 days. Specimen are kept for 30 days.

Sample are drawn by customer. As received by the customer, the sample was accepted for testing. The sample description is based only on customer declaration/information.

Limits are based on Customer's Manual in force available at Intertek Italia S.p.A. - Via di Stagno, 17 F/G - 50055 Lastra a Signa (FI)

Uncertainty is the extended uncertainty calculated using a coverage factor of 2 which gives a level of confidence of approximately 95%.

All the results are reported without considering the uncertainty.

This test report shows the logo of Intertek Italia Spa, as the testing laboratory that performed the tests. The possible presence of other logos is due to the explicit request of the customer to have their own logo on the test report.

UM:Unit of Measurement


LQ:Quantification Limit


RESULTS MARKED IN RED EXCEED LIMITS

This report is made solely on the basis of your instructions and/or information and materials supplied by you. It is not intended to be a recommendation for any particular course of action. Intertek does not accept a duty of care or any other responsibility to any person other than the Client in respect of this report and only accepts liability to the Client insofar as is expressly contained in the terms and conditions governing Intertek's provision of services to you. Intertek makes no warranties or representations either express or implied with respect to this report save as provided for in those terms and conditions. We have aimed to conduct the Review on a diligent and careful basis and we do not accept any liability to you for any loss arising out of or in connection with this report, in contract, tort, by statute or otherwise, except in the event of our gross negligence or wilful misconduct.

END OF TEST REPORT

Laboratory Manager



Ilenia Francioni
ilenia.francioni@intertek.com


Dott. Luca Di Monte
 Ordine dei Chimici e dei Fisici della Toscana
 Sez. A Chimico n°2323
luca.dimonte@intertek.com



LAB N° 0579 L

Intertek Italia S.p.a.

Administrative Office Via Miglioli, 2/A - 20063 Cernusco Sul Naviglio (MI)

Operational Office Via di Stagno 17 F/G - 50055 Lastra a Signa (FI)

Tel. 0039055790873 Fax 0039055791198

Validated by: Ilenia Francioni